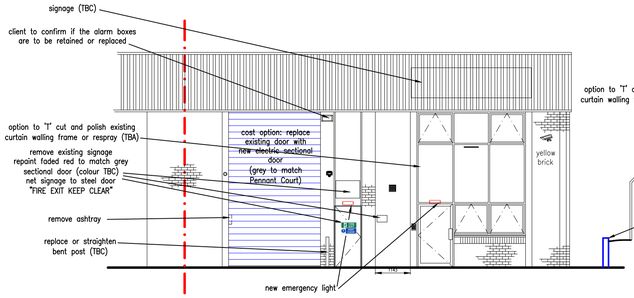

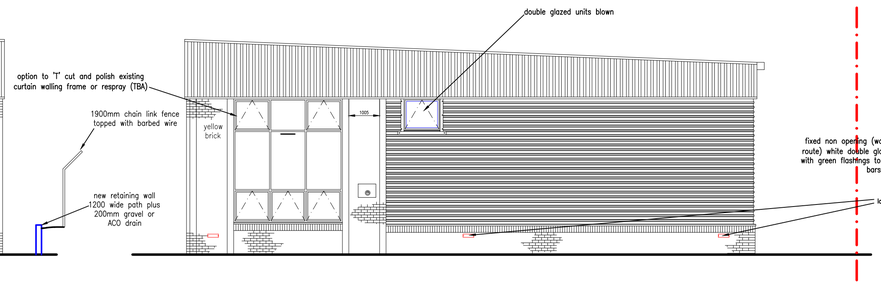

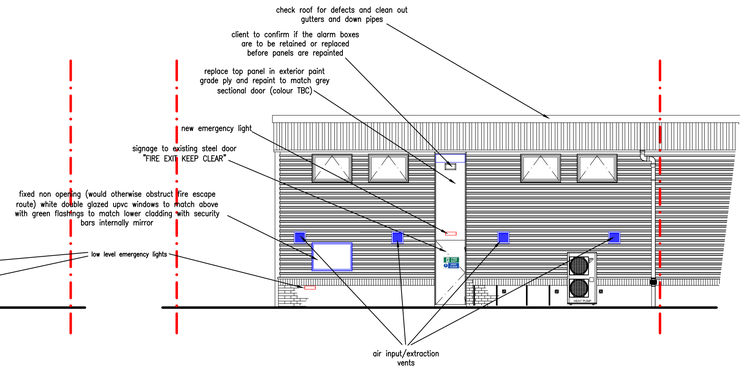

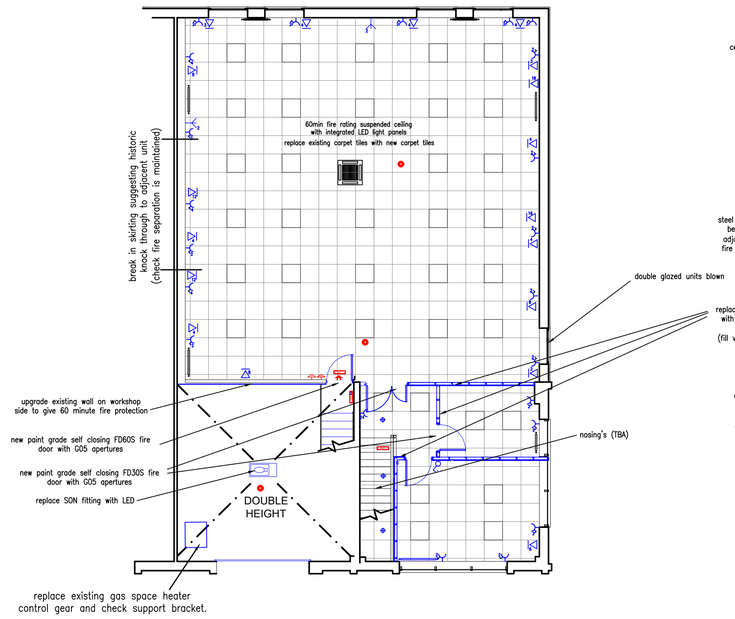

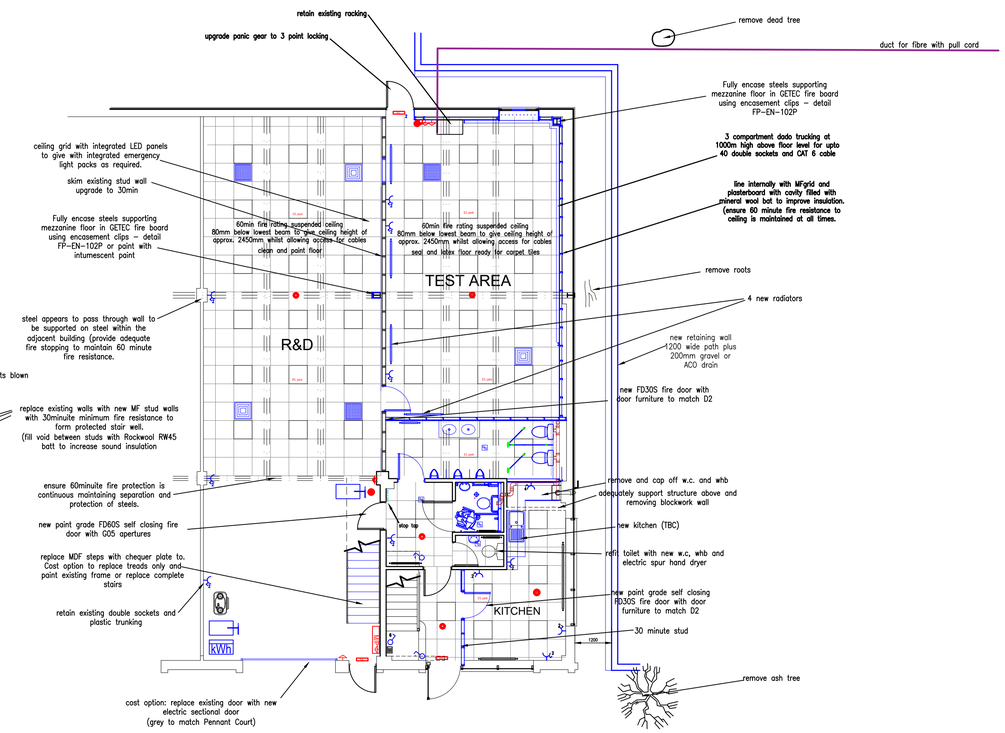

Fire Key

- M/P — Main Panel
- E/L — Emergency lighting (maintained) to give 0.5 lux minimum to BS5266 Pt. 7/EN1838 - 4.3
- E/L pack — Integral emergency lighting (maintained) to give 1 lux minimum to BS5266 Pt. 1
- Lighted directional signage with integral emergency lighting (maintained) or maintained lighting above
- Call point
- Sounder
- Smoke detector
- Heat detector
- CO2
- Foam extinguisher
- F/B — Fire Blanket
- Emergency Door Release

KEY

- Single pole one way switch
- Multi switch
- Two-way switch
- Cord operated one-way switch
- Rheostat or dimmer switch
- PIR — PIR
- Down Lighter
- Ceiling Light
- Wall light
- Bulk Head Light
- Single tube fluorescent
- Spot Light
- Fuse spur
- Single Socket
- Multi Socket
- Multi Socket with USB socket/s — 2 (USB)
- Radiant wall heater
- Aerial
- Fan
- kWh — Meter
- Mainswitch/Distribution
- T — Telecom
- Cat 6 network jack.
- Fan switch

REV	DATE	

PSK architect
New Build & Commercial Architect

TITLE

Commercial Unit
CHELTENHAM

DESCRIPTION

SHEET 2 OF 2

DATE	SCALE
05/11/2021	1/100
DRAWN	CHECKED
A. Davis	--------

DRAWING NO.

CC50 PSK 00